


Basal	IE/BE	mg/IE
0.5	0.6	70
0.6	0.75	66
0.7	0.85	62
0.8	1	58
0.9	1.1	54
1.0	1.2	50
1.1	1.35	47
1.2	1.5	44
1.3	1.6	41
1.4	1.7	38
1.5	1.8	35
1.6	1.95	33
1.7	2.1	31
1.8	2.2	29
1.9	2.3	27
2.0	2.4	25
2.1	2.55	24
2.2	2.7	23
2.3	2.8	22
2.4	2.9	21
2.5	3.0	20

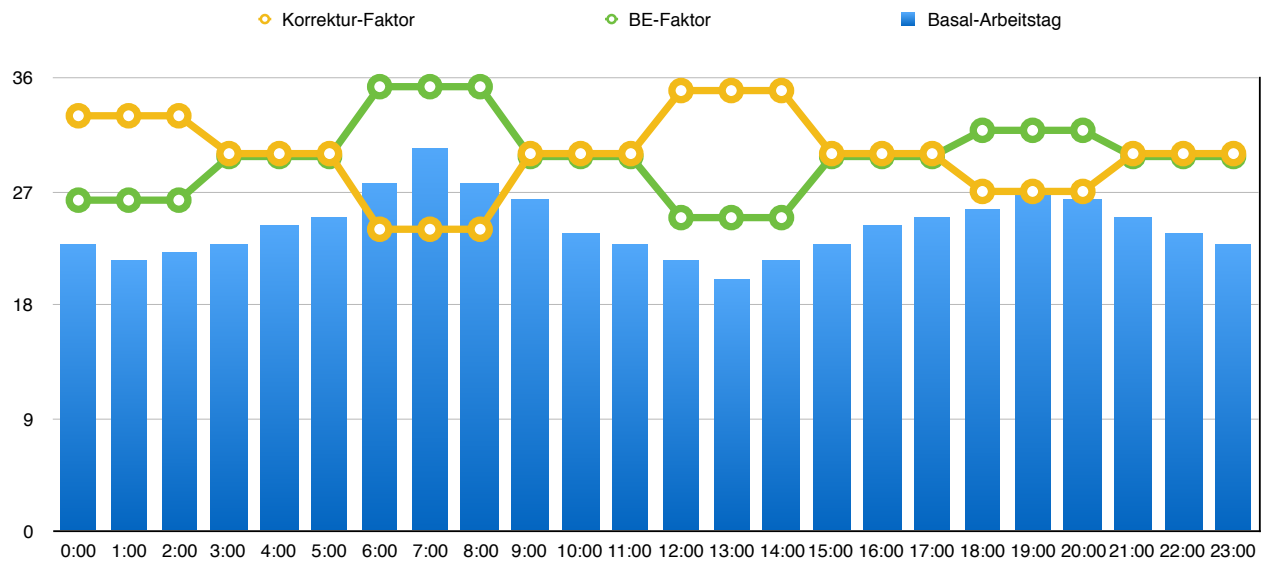

	Basal	BE-F.	Korr.-F.
0:00	1.65	1.9	33
1:00	1.55	1.9	33
2:00	1.6	1.9	33
3:00	1.65	2.15	30
4:00	1.75	2.15	30
5:00	1.8	2.15	30
6:00	2.0	2.55	24
7:00	2.2	2.55	24
8:00	2.0	2.55	24
9:00	1.9	2.15	30
10:00	1.7	2.15	30
11:00	1.65	2.15	30
12:00	1.55	1.8	35
13:00	1.45	1.8	35
14:00	1.55	1.8	35
15:00	1.65	2.15	30
16:00	1.75	2.15	30
17:00	1.80	2.15	30
18:00	1.85	2.3	27
19:00	1.95	2.3	27
20:00	1.9	2.3	27
21:00	1.8	2.15	30
22:00	1.7	2.15	30
23:00	1.65	2.15	30